


| IF "A" IS | IF "B" IS | THEN SANITARY SEWER PIPE SEGMENT SHALL BE |
|---------------|---------------|--------------------------------------------------------------------------------------------------------------------------|
| 18" OR MORE | 10' OR MORE | NO SPECIAL PIPE MATERIAL OR GRADE REQUIREMENTS |
| LESS THAN 18" | LESS THAN 10' | PVC (EITHER ASTM D 2241 (SDR 21) OR ANSI/AWWA C900 (DR 18) OR ANSI/AWWA C905 (DR 21) OR DUCTILE IRON (CLASS 51 MINIMUM)) |

NOTE: SEPARATION DISTANCES FROM WATER SUPPLIES AND PIPE CLASSIFICATIONS SHALL CONFORM TO INDIANA STATE BOARD OF HEALTH'S "ON-SITE WATER SUPPLY AND WASTEWATER DISPOSAL FOR PUBLIC AND COMMERCIAL ESTABLISHMENTS - BULLETIN S.E. 13"

WELL/WATER SUPPLY & SEWER CROSSING DETAIL

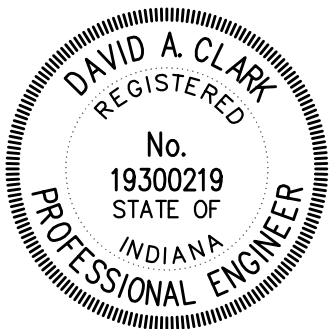

David A. Clark



CLAY TOWNSHIP REGIONAL WASTE DISTRICT
WATER LINE CROSSING DETAIL

